

Khyber Pakhtunkhwa Health Roadmap

24/7 Functionality of RHCs




February, 2017

IMU conducted a rapid assessment to identify the input gaps in RHCs for 24/7 functionality


Indicators	Evaluation criteria
Location	>10 km distance from nearest government 24/7 facility
Infrastructure	Availability of one inpatient ward, operation room and delivery room
Utilities	Availability and functionality of electricity, backup electricity, water supply system and boundary wall
Staff	Sanctioned and filled posts of 3 Medical officers, 3 Nurses/LHV, 3 technicians and 1 guards
Equipment	Availability and functionality of critical equipment
Residence	Availability of 2 rooms in average condition

IMU has identified 14 RHCs located in the vicinity of a 24/7 public health facility

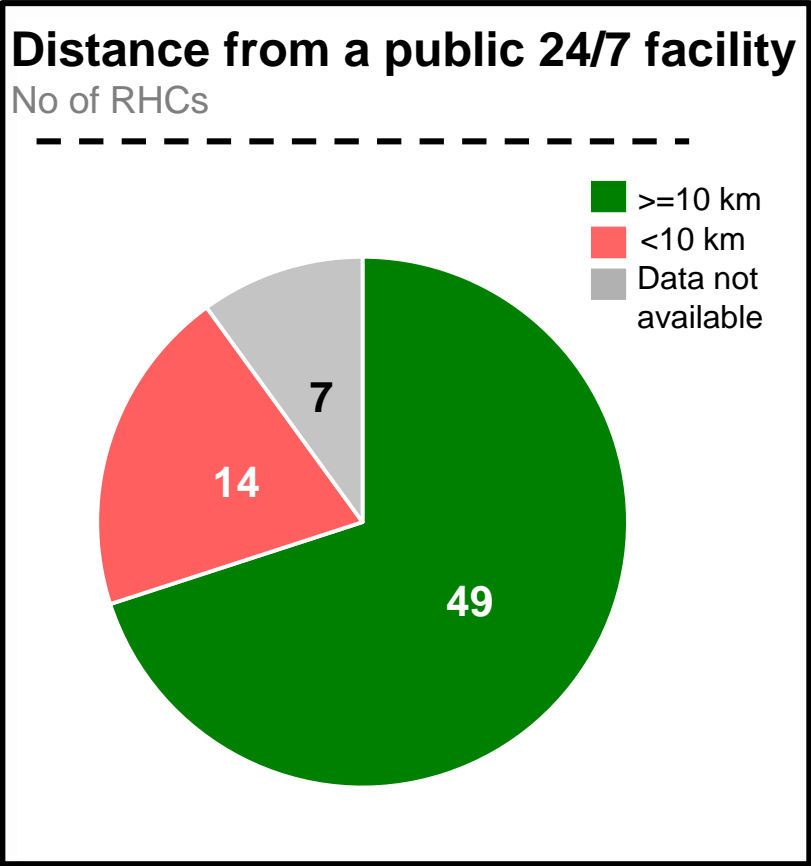


IMU will share the list of 14 identified RHCs with DHOs for further analysis of whether the facility should be an RHC or a BHU

All RHCs require additional resources for 24/7 functionality

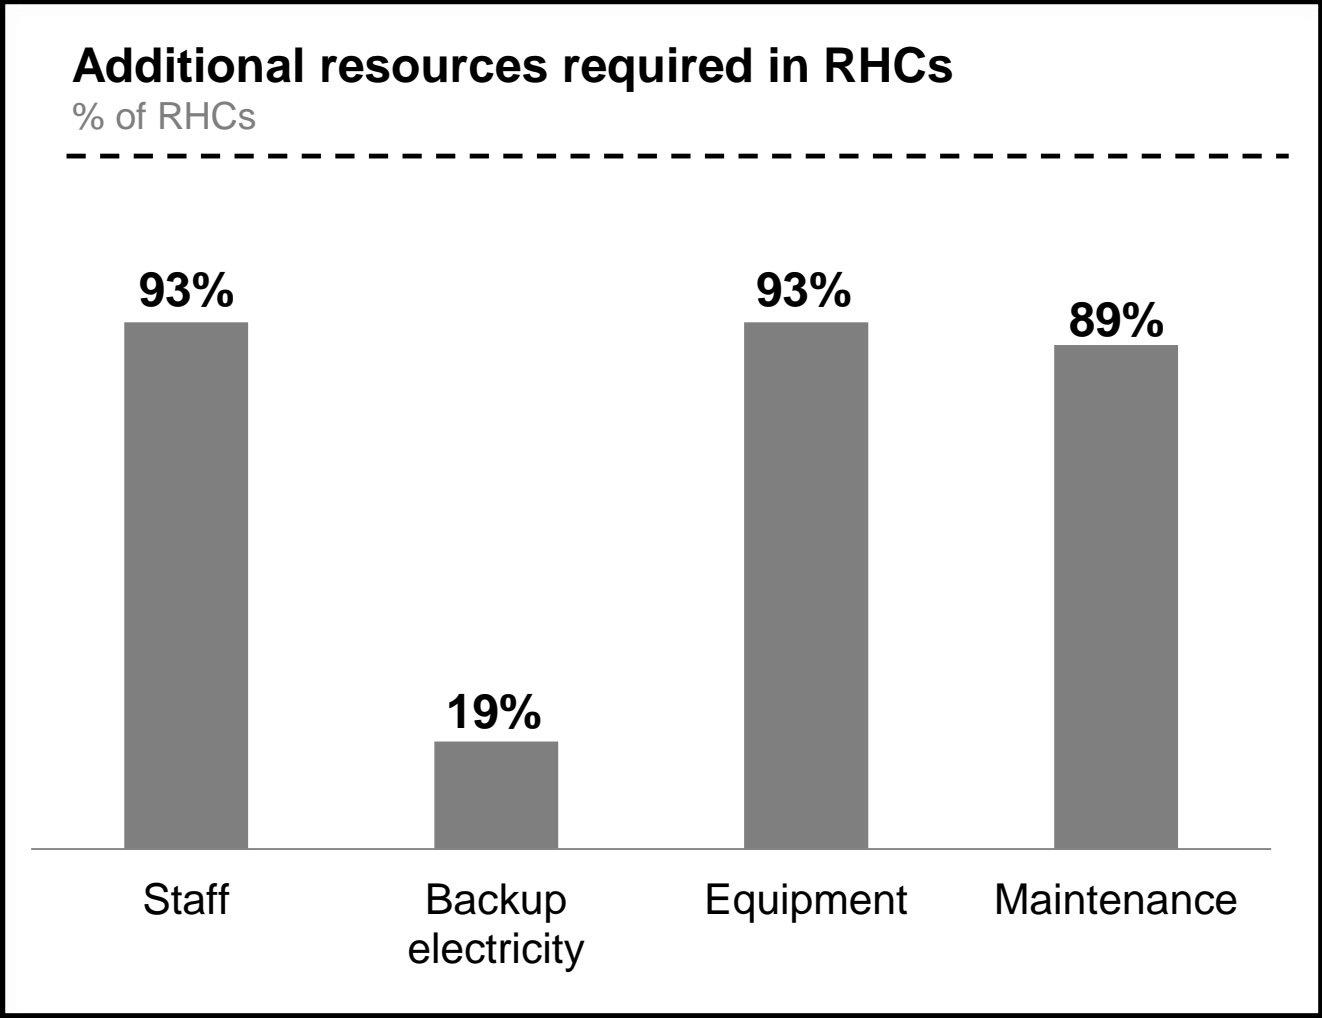

All RHCs are missing at least one of the basic requirement for 24/7 functionality

Department needs to work with C&W department to provide basic facilities in 41 RHCs

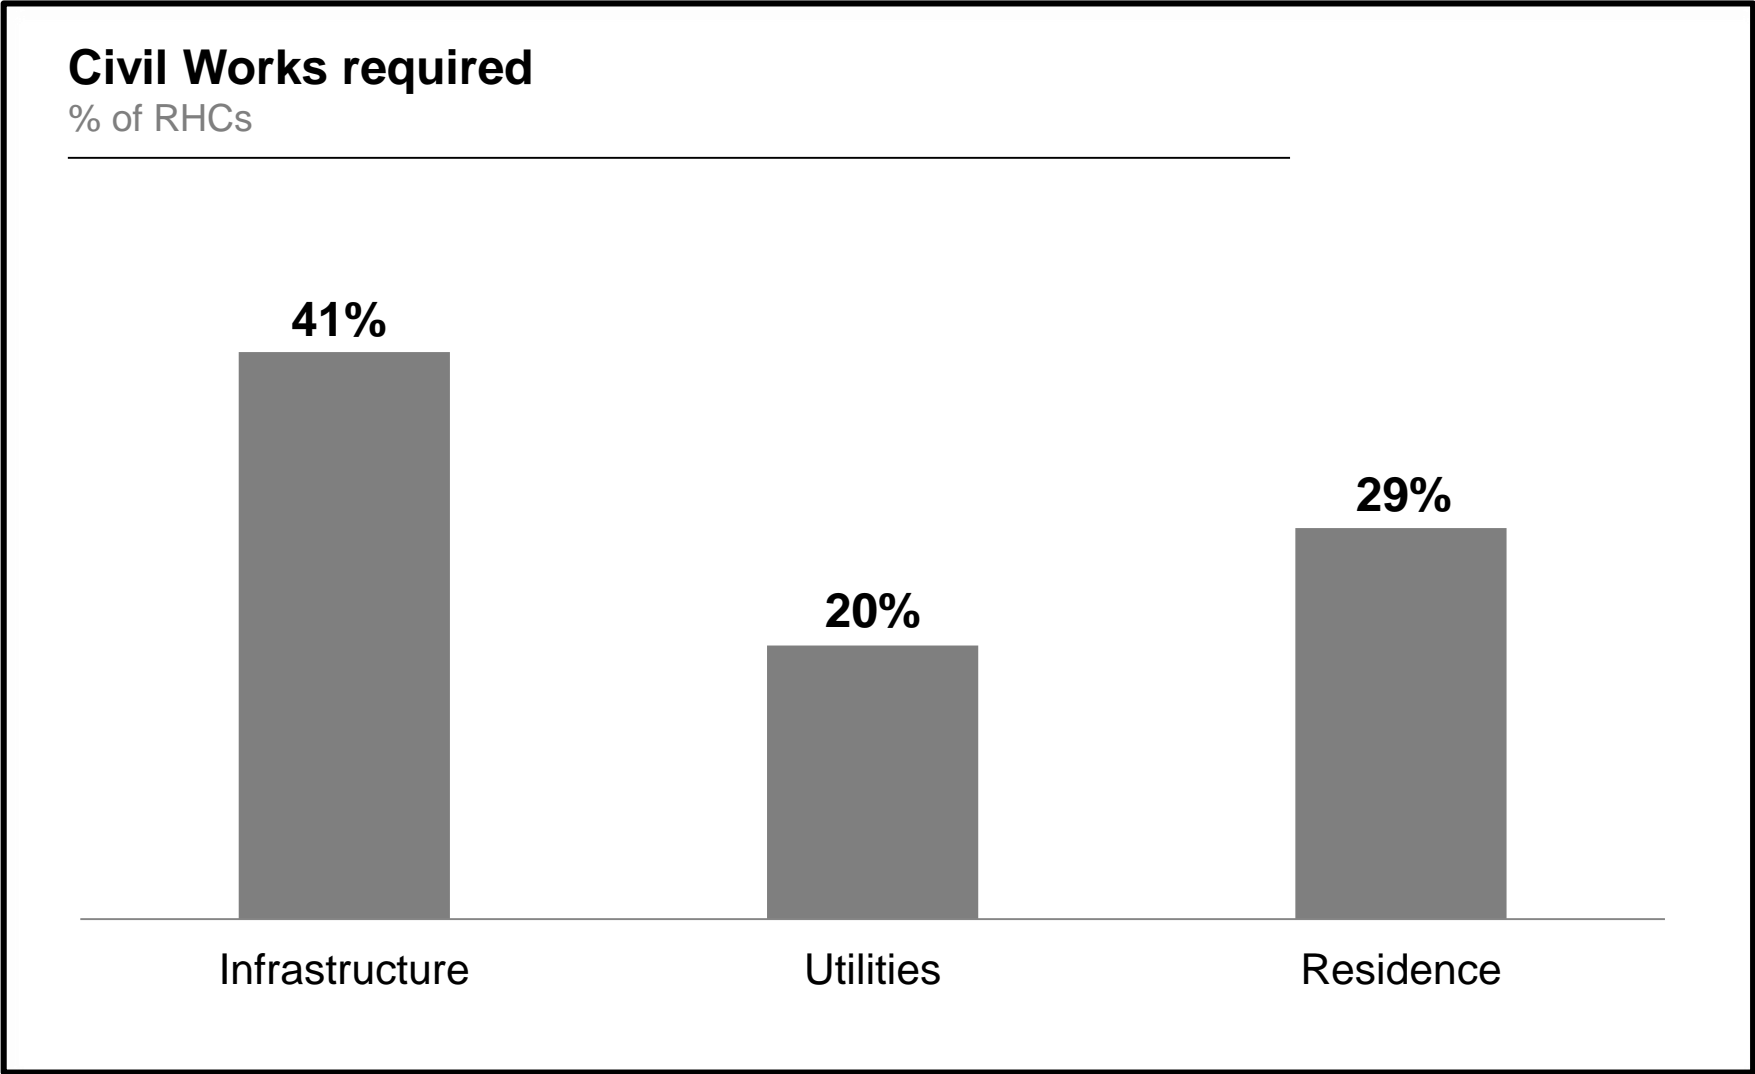

Plan on 24/7 functionality of RHCs

Staff	Responsible	Timeline	Comments	
1	Fill all sanctioned posts of medical officers in RHCs	Secretary Health	15 March 2017	<input type="checkbox"/>
2	Ensure at least three sanctioned posts of medical officers (BPS-17) in all RHCs	DGHS	15 March 2017	<input type="checkbox"/>
3	Develop SNE for additional paramedics and support staff for RHCs	DGHS	28 Feb 2017	SNE for additional posts has been developed <input checked="" type="checkbox"/>
Back up Electricity				
4	Share the details of availability and functionality of generators and UPS in RHCs	PD IMU	4 March 2017	<input type="checkbox"/>
5	Ensure adequate POL for generator is budgeted and released to RHCs	DGHS	30 March 2017	<input type="checkbox"/>
6	Repair non-functional UPS and generators from district health plan budget	DGHS	15 April 2017	<input type="checkbox"/>
7	Develop a plan to purchase UPS for RHCs without back up electricity	DGHS	30 March 2017	<input type="checkbox"/>
Equipment				
8	Share the details of availability and functionality of critical equipment	PD IMU	4 March 2017	<input type="checkbox"/>
9	Repair non-functional equipment from district health plan budget	DGHS	30 March 2017	<input type="checkbox"/>
10	Develop a plan to purchase non available equipment for RHCs	DGHS	15 April 2017	<input type="checkbox"/>

Plan on 24/7 functionality of RHCs

Maintenance	Responsible	Timeline	Comments
11 Share the details of maintenance required in RHCs	PD IMU	04 March 2017	<input type="checkbox"/>
12 Develop a plan to repair the utilities and infrastructure from district health plan	DGHS	30 March 2017	<input type="checkbox"/>
Civil works			
13 Appoint a focal person from DGHS office to coordinate with C&W department	DGHS	4 March 2017	<input type="checkbox"/>
14 Compile all civil works upgradation required in RHCs	DGHS	15 March 2017	<input type="checkbox"/>
15 Conduct a meeting with C&W department for upgradation of RHCs	DGHS	30 March 2017	<input type="checkbox"/>
Routine			
16 Conduct fortnightly review of the progress of the plan with key stakeholders	DGHS	Continuous	<input type="checkbox"/>